


BATESON BUILDING AIRBORNE MOLD SPORES* MAY 24, 2002

BATESON BUILDING AIRBORNE MOLD SPORES* - MAY 24, 2002 - These results show that molds found indoors are similar in type and distribution to those found outdoors. Airborne indoor mold concentrations are lower than outdoors.

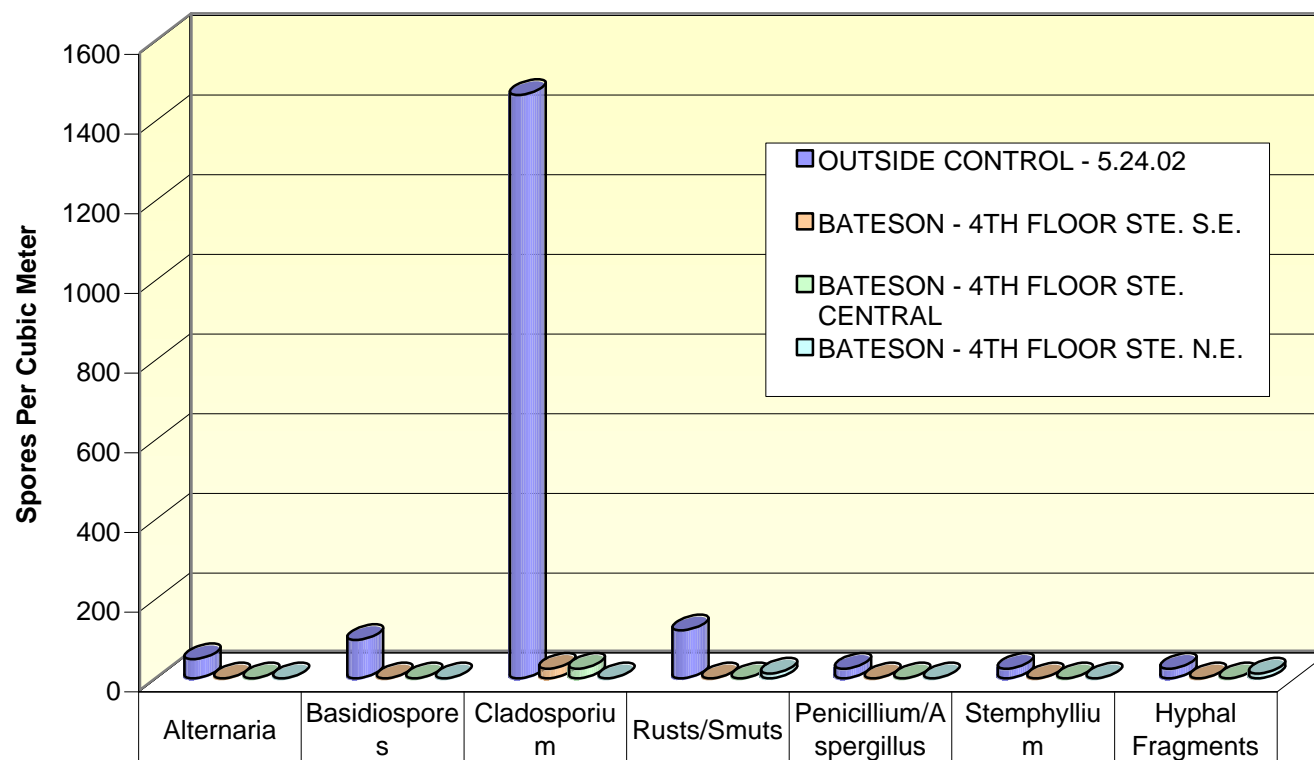

	Alternaria	Basidiospores	Cladosporium	Rusts/Smuts	Penicillium/A. spargillus	Stemphylium	Hyphal Fragments
OUTSIDE CONTROL - 5.24.02	48	96	1464	120	24	24	24
BATESON - 4TH FLOOR STE. S.E.	0	0	24	0	0	0	0
BATESON - 4TH FLOOR STE. CENTRAL	0	0	24	0	0	0	0
BATESON - 4TH FLOOR STE. N.E.	0	0	0	12	0	0	12

*Spore Trap, Non-Culturable Collection Analysis

Organism Identification